



NOTE:
COVER WITH STEEL PLATE UNTIL
FINAL ASPHALT IS INSTALLED

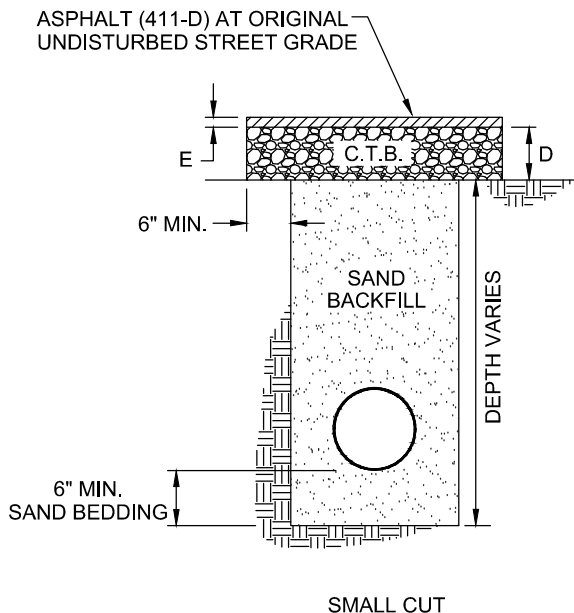

NOTE:
INSTALL CR610 FLUSH WITH EXISTING
ASPHALT UNTIL FINAL ASPHALT IS INSTALLED

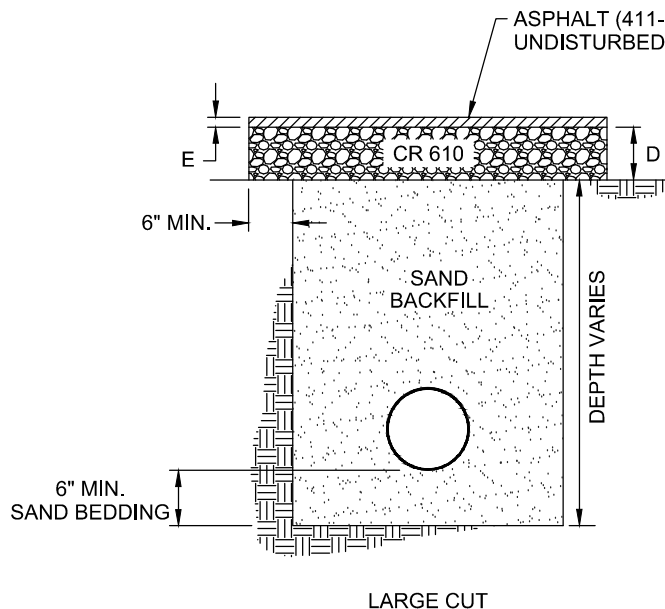

NOTES:

- 1) ALL CONCRETE PATCH WORK MUST BE APPROVED BY THE TOWN ENGINEER PRIOR TO PLACEMENT.
- 2) CEMENT TREATED BASE MUST BE PLACED AND COMPACTED WITHIN 3 HOURS OF THE TIME IT IS LOADED AT THE PLANT.
- 3) GRANULAR BACKFILL SHALL BE CONSOLIDATED WITH A VIBRATING PLATE COMPACTOR.
- 4) CEMENT TREATED BASE SHALL BE A PUGMILLED GRAVEL MIX WITH NO LESS THAN 10% CEMENT BY VOLUME.
- 5) EDGES ARE TO BE TRIMMED TO A STRAIGHT VERTICAL LINE. ANY LOOSE OR DISTURBED PAVEMENT MUST BE REMOVED AND REPLACE (TYPICAL).
- 6) PRIME ALL EDGES OF ASPHALT PRIOR TO PLACING ASPHALT.
- 7) SAND BACKFILL SHALL BE INSTALLED IN 10" MAXIMUM LOOSE LIFTS AND MECHANICALLY COMPACTED.

STREET CLASSIFICATION	D	E
MAJOR	18"	3"
COLLECTOR	16"	2"
OTHER	12"	2"

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

**TOWN OF COLLIERVILLE
STREET CUT
REPAIR DETAIL**

TOC-526