


*DISTANCES MAY VARY DEPENDENT UPON PROJECT

- NOTES:
- PUBLIC FIRE HYDRANTS TO BE SILVER IN COLOR
 - PRIVATE FIRE HYDRANTS TO BE RED IN COLOR
 - CONCRETE PAD AROUND VALVE BOX TO BE 1" BELOW FINISHED GRADE.

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
FIRE HYDRANT ASSEMBLY


TOC-401

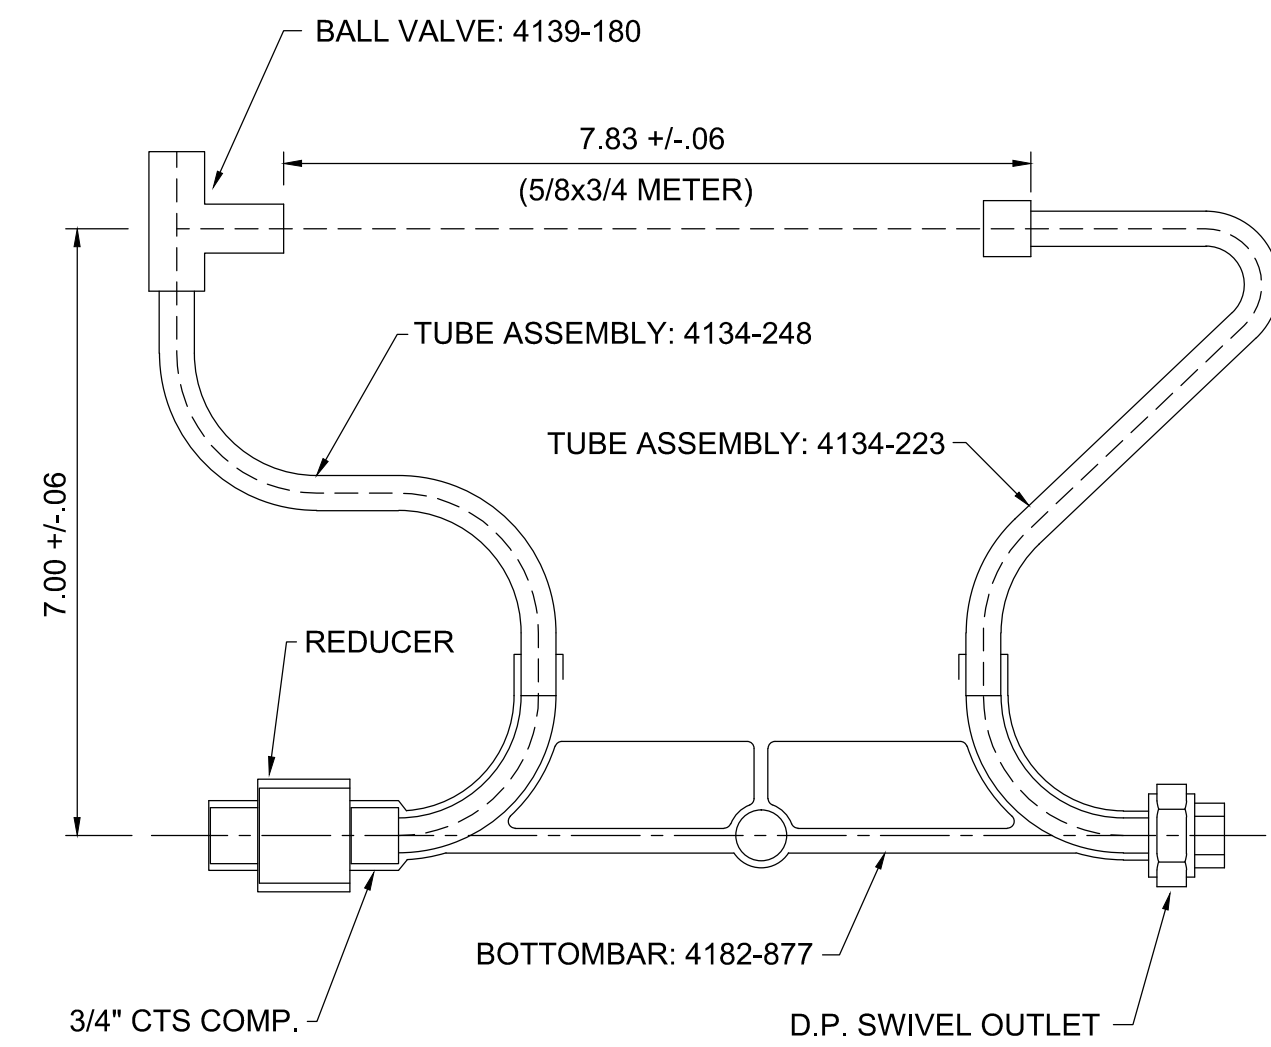

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE
1	REMOVED 1" CORP STOP	7-18-2012
2	REMOVED SOLDER ADDED D.P. SWIVEL OUTLET	11-1-2016

TOWN OF COLLIERVILLE
WATER METER SETTER

SCALE: NONE TOC-402

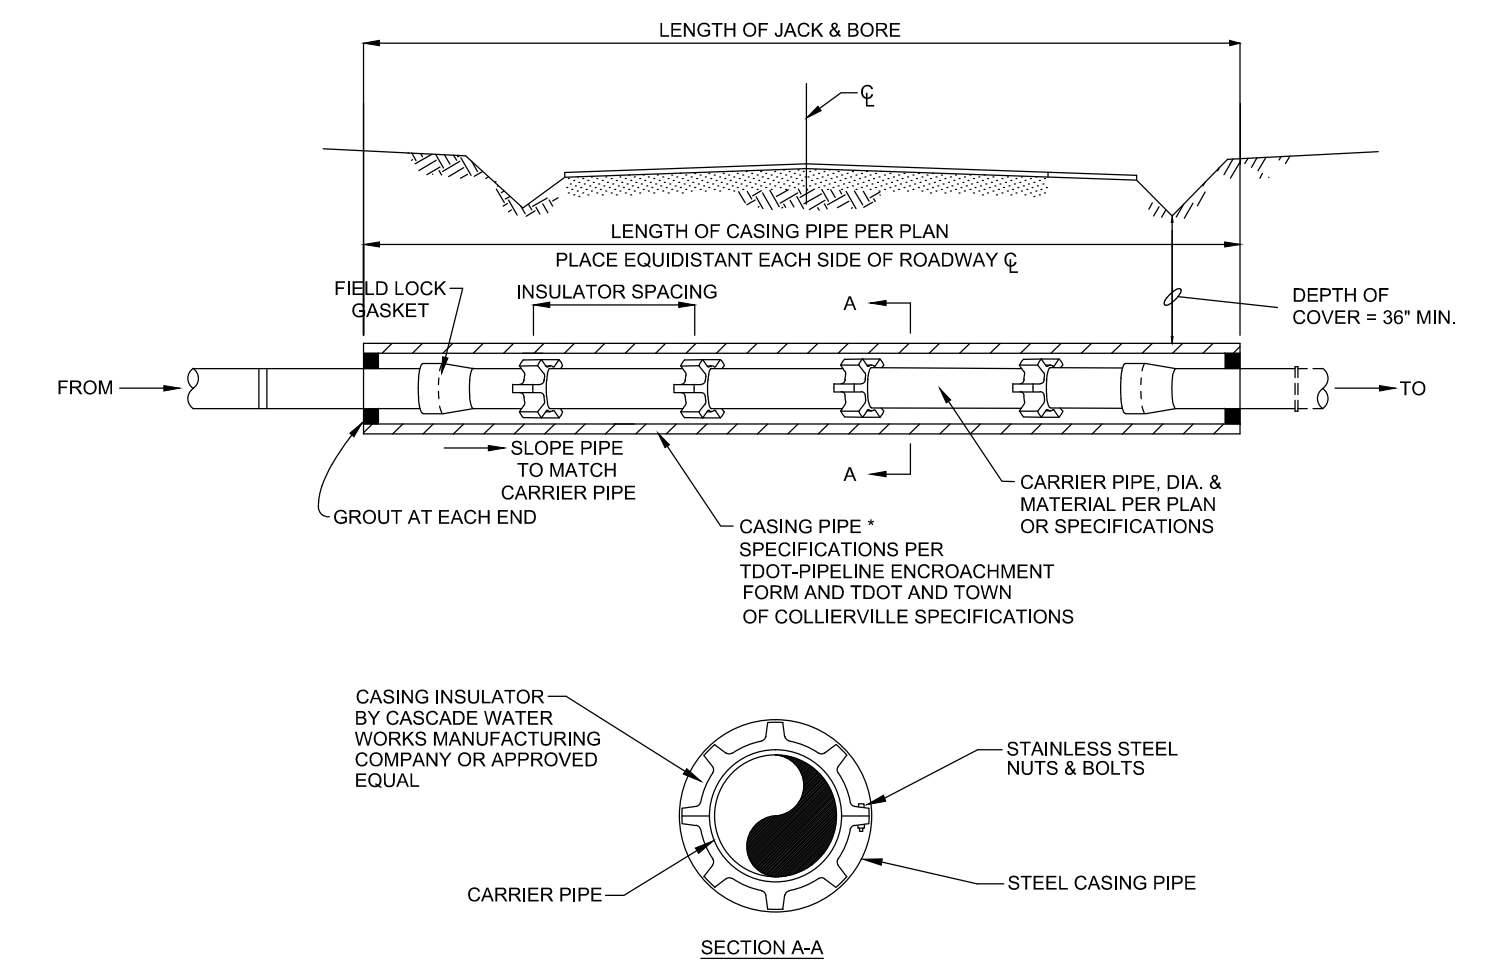


NOTES:

- CASING INSULATORS SHALL BE MADE WITH SPECIAL RUNNER HEIGHTS SO AS NOT TO INTERFERE WITH PIPE JOINTS.
- ALL CARRIER PIPES MUST HAVE FIELD LOCK GASKETS.
- INSULATOR SPACING SHALL BE AS REQUIRED BY THE MANUFACTURER, HOWEVER, NOT LESS THAN FOUR (4) CASING INSULATORS SHALL BE INSTALLED PER LENGTH OF PIPE.
- CASING LENGTH SHALL EXTEND A MINIMUM OF 7 FEET BEYOND THE EDGE OF PAVEMENT OR CURBING.
- SEE PLANS FOR CASING SIZE.

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
JACK AND BORE


TOC-404

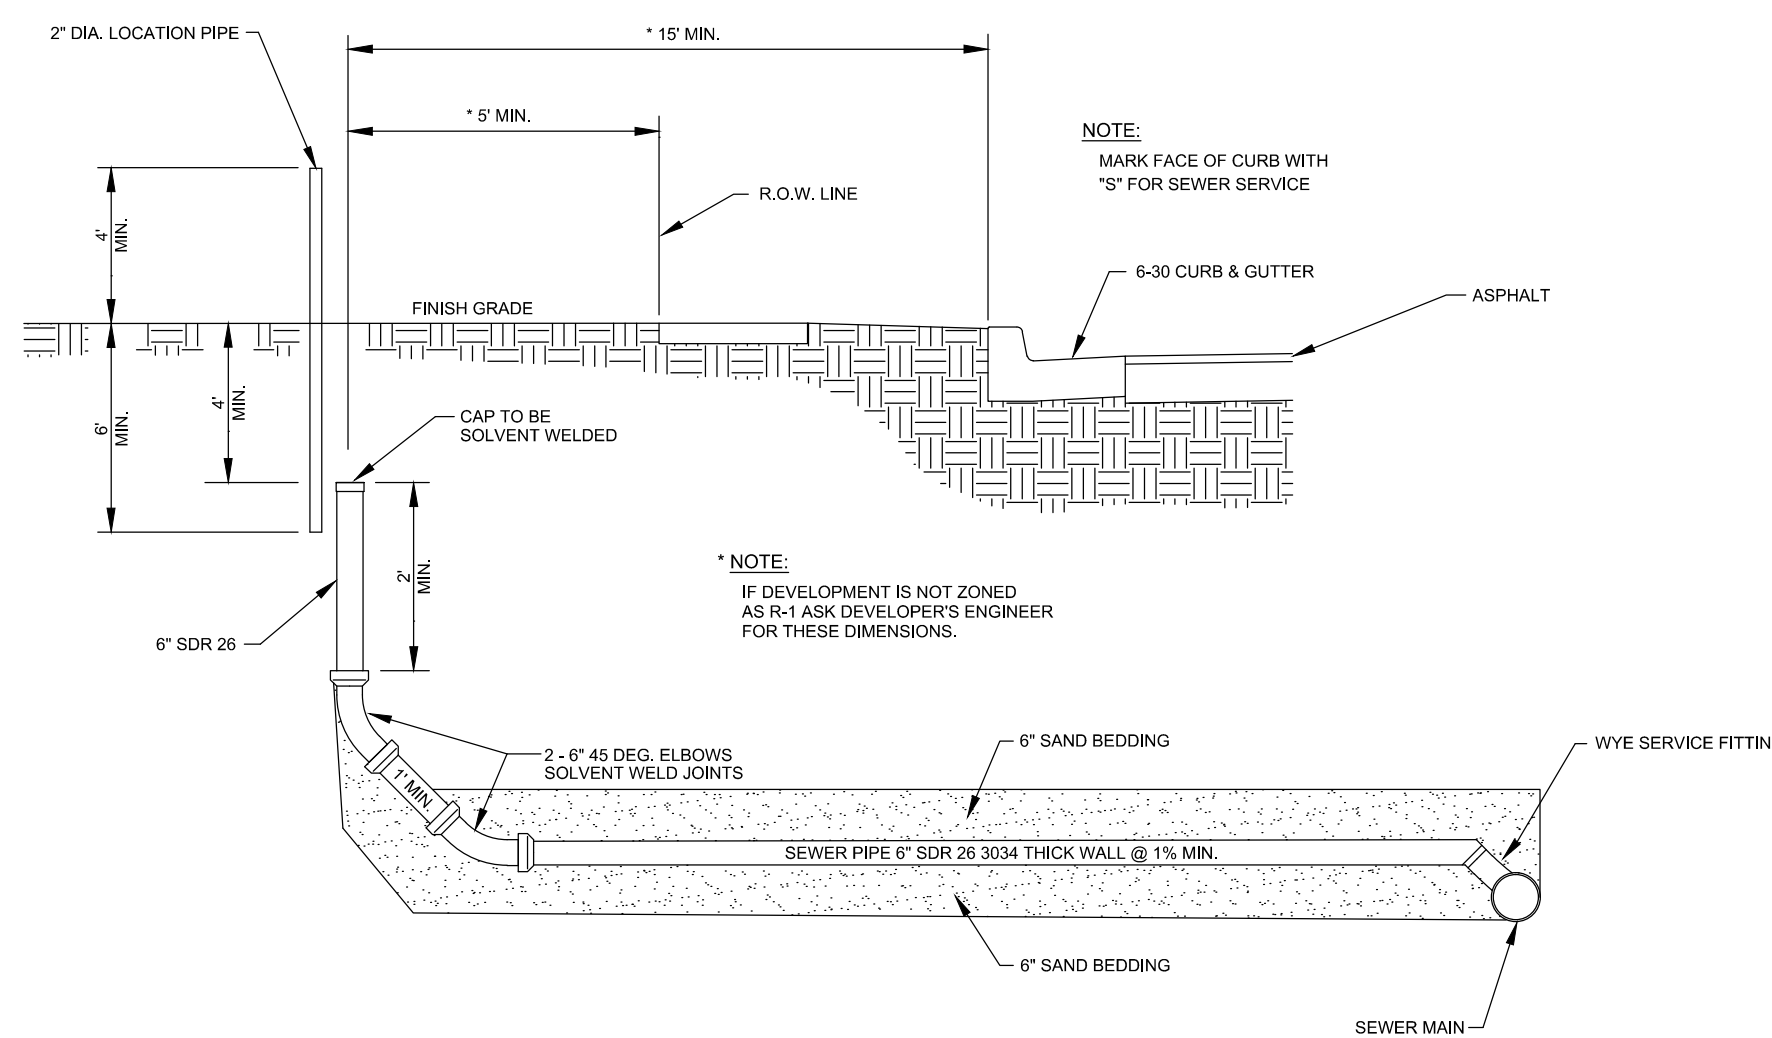

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
TYPICAL HOUSE
SEWER DETAIL


TOC-304

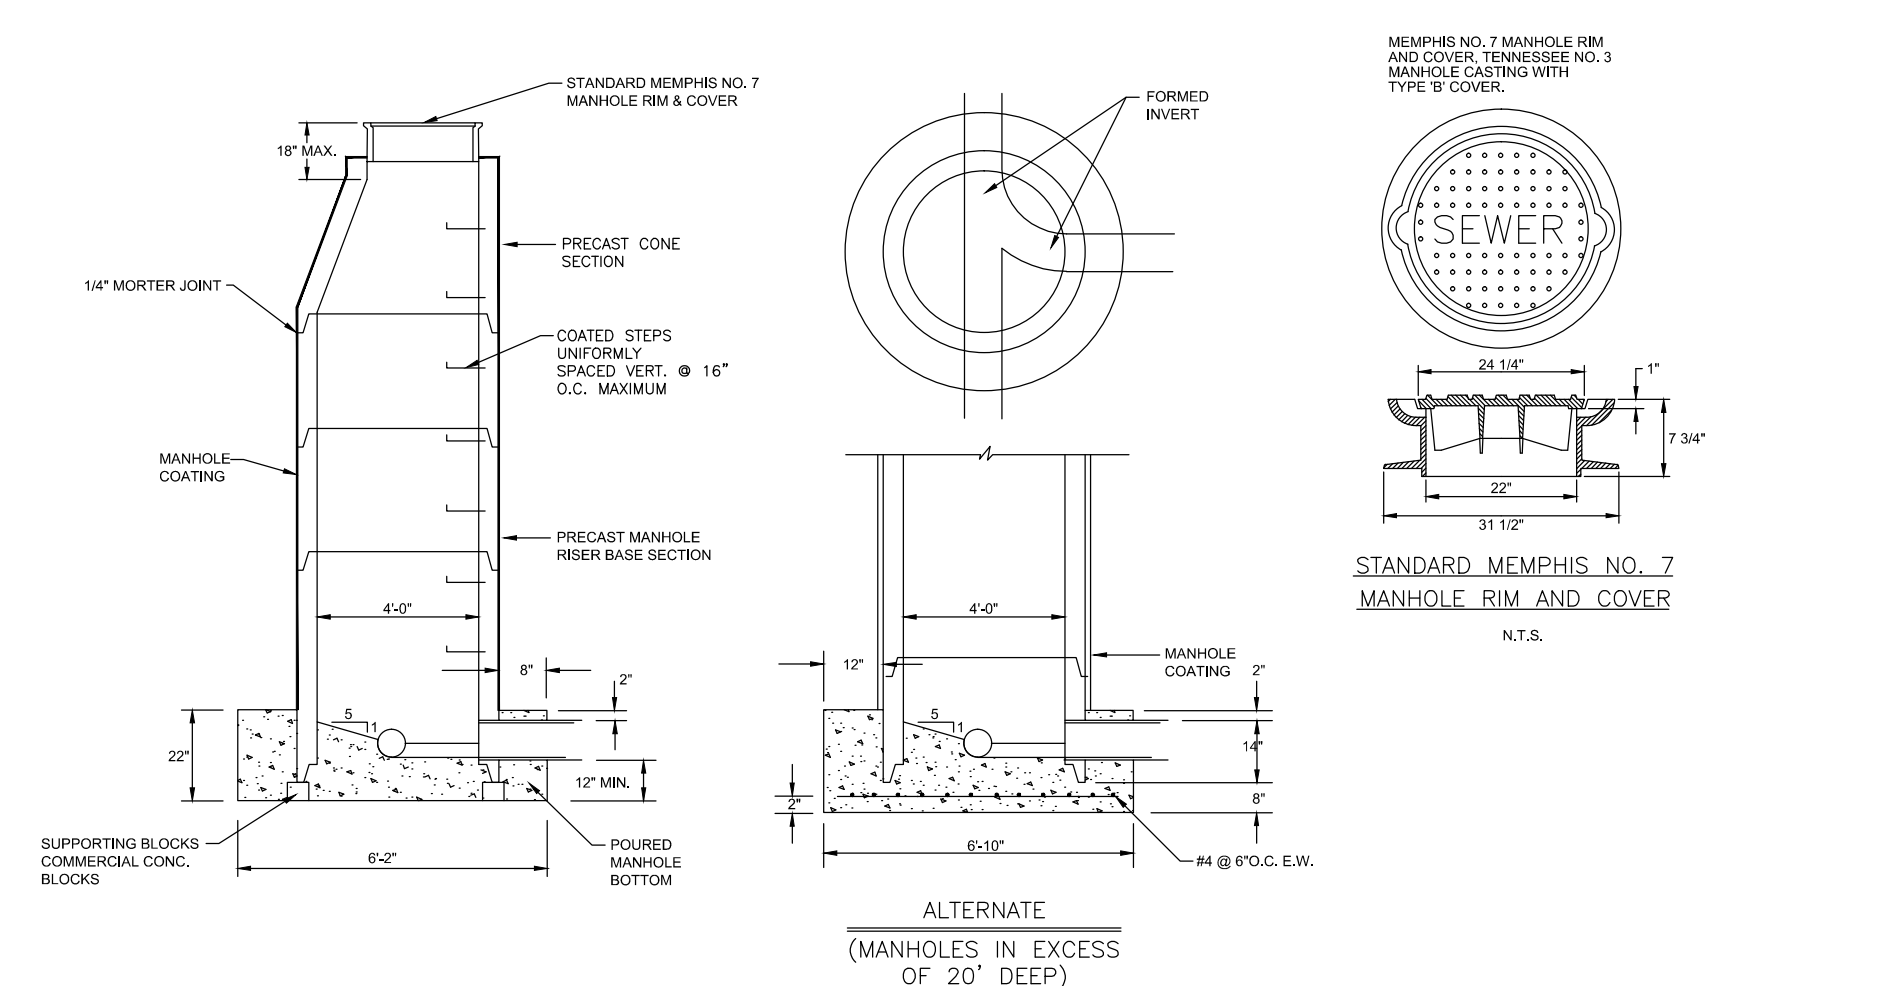

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
PRECAST SEWER MANHOLE
POURED BOTTOM DETAIL


TOC-312

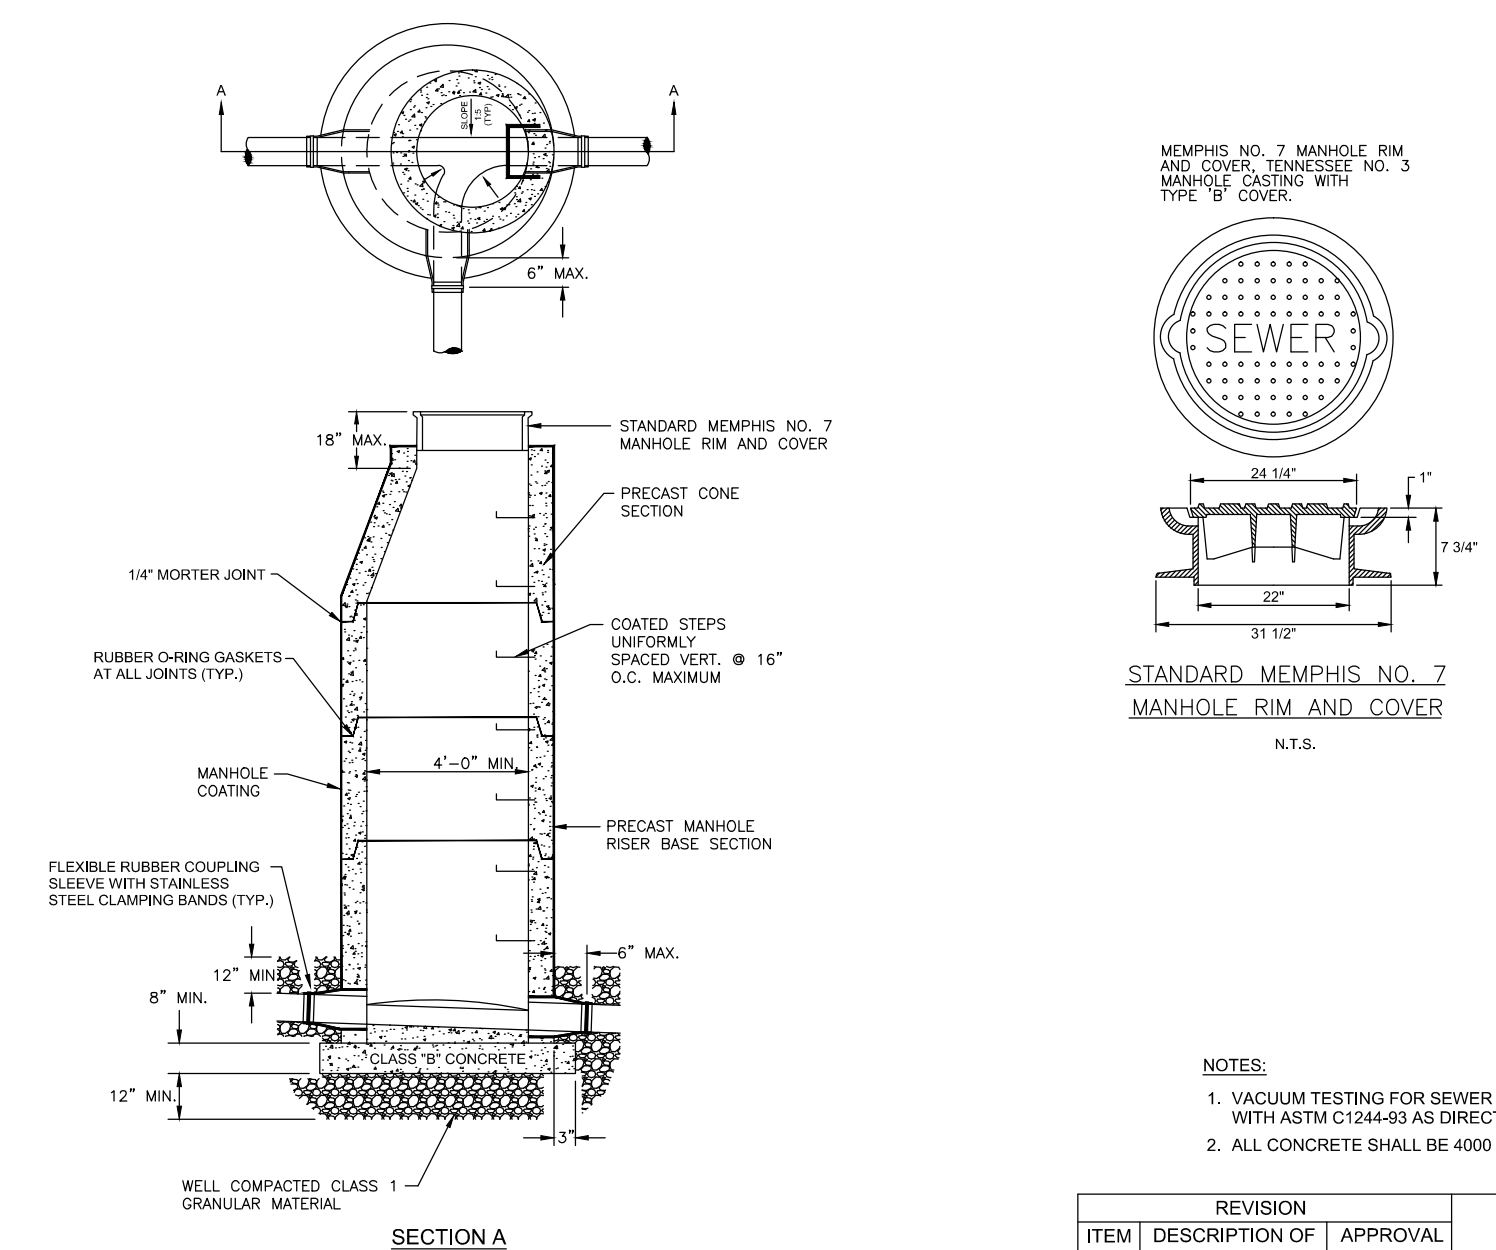

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
PRECAST SEWER MANHOLE
DETAIL


TOC-313

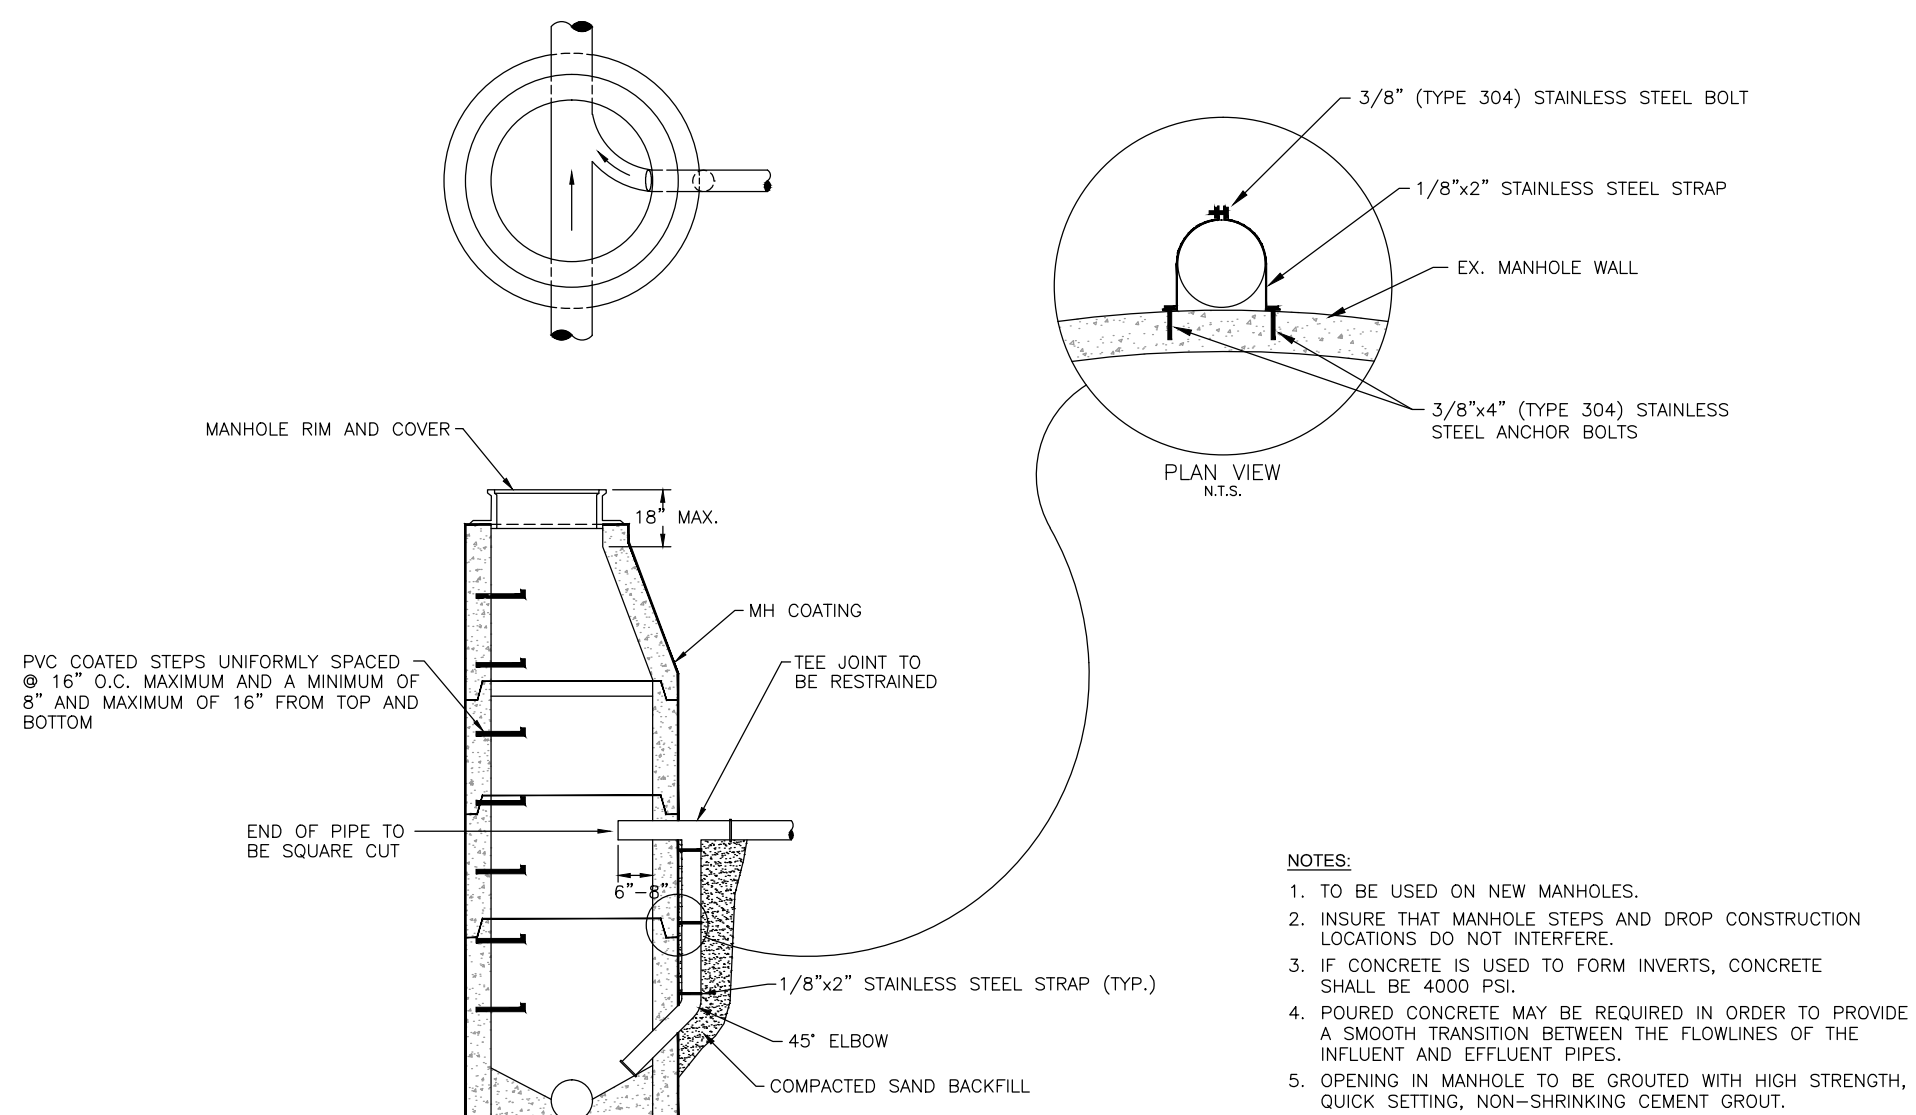

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
SANITARY MANHOLE-OUTSIDE
DROP CONSTRUCTION

SCALE: NONE TOC-314

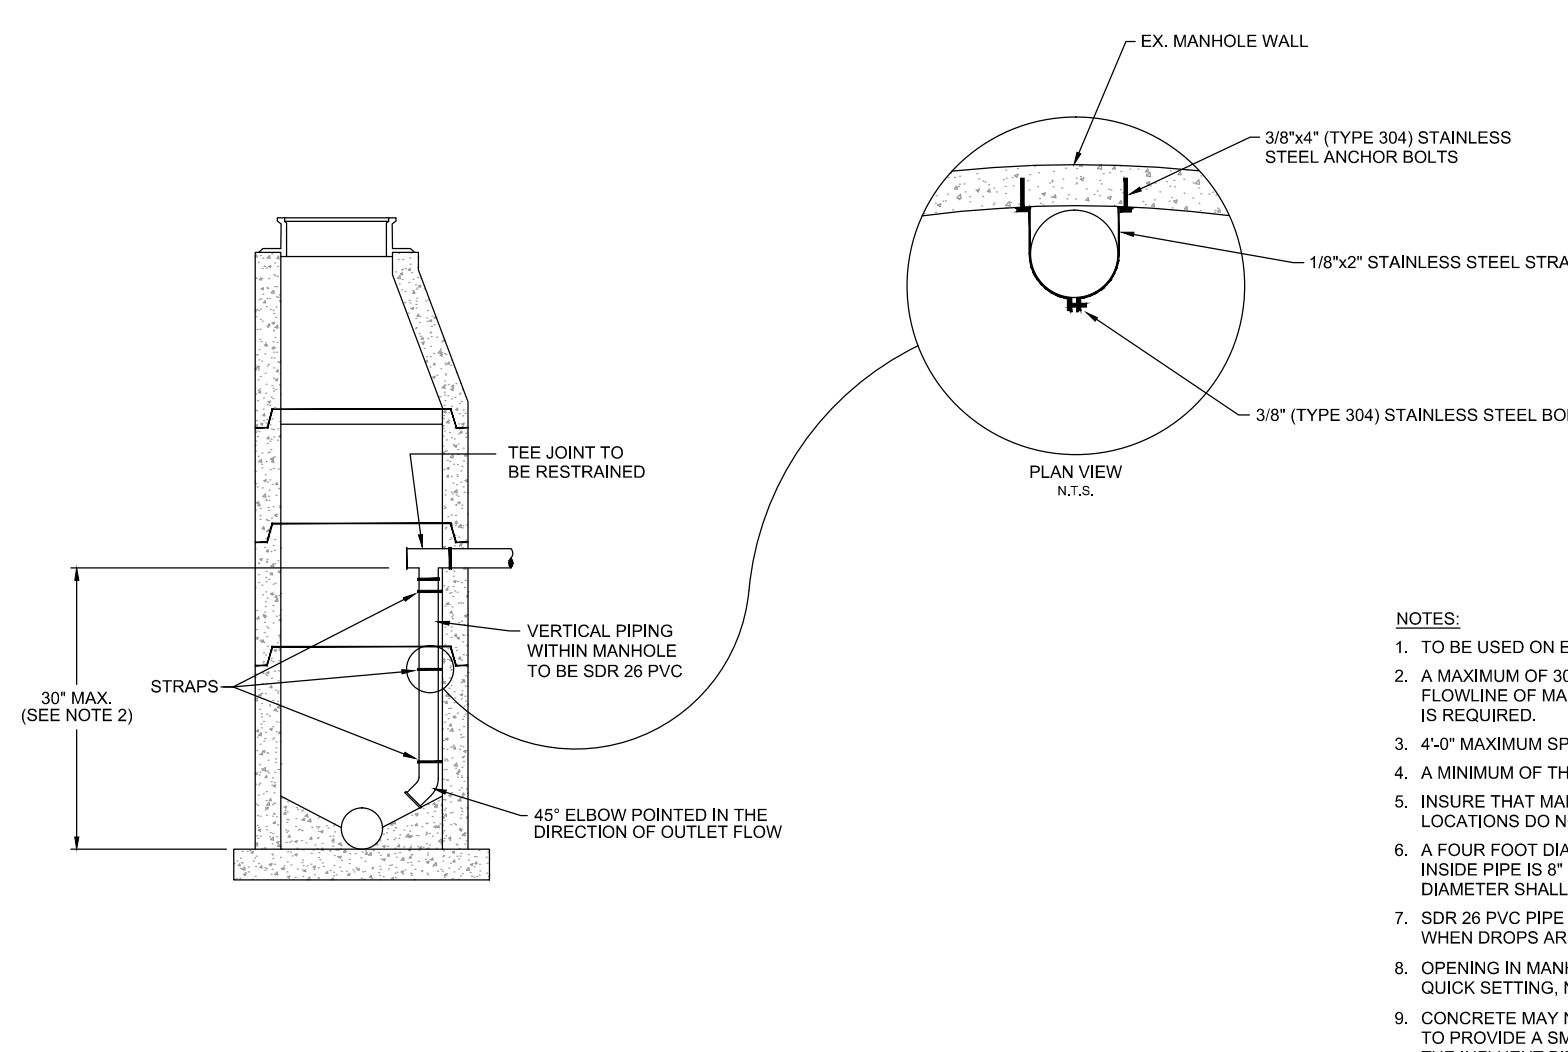

REVISION		
ITEM NO.	DESCRIPTION OF CHANGE	APPROVAL DATE

TOWN OF COLLIERVILLE
SANITARY MANHOLE-INSIDE
DROP CONSTRUCTION

SCALE: NONE TOC-315